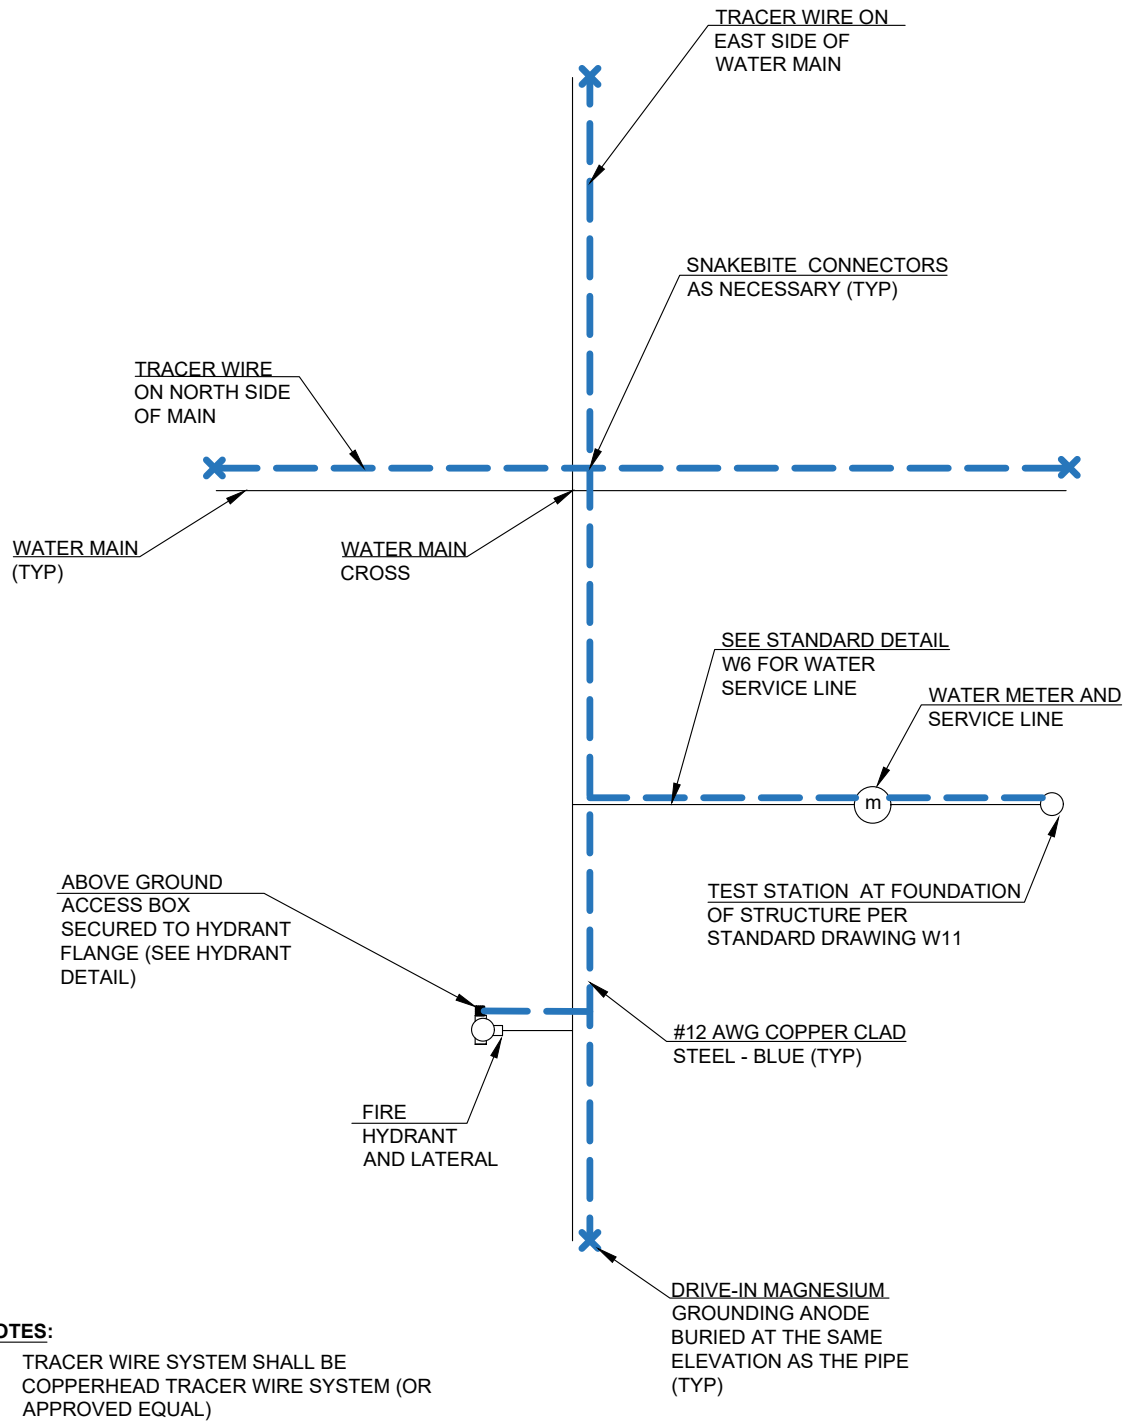

NOTES:

1. TRACER WIRE SYSTEM SHALL BE COPPERHEAD TRACER WIRE SYSTEM (OR APPROVED EQUAL)
2. TRACER WIRE SYSTEM SHALL BE INSTALLED PER MANUFACTURER AND NTM SPECIFICATIONS.
3. WIRE SHOWN AWAY FROM PIPE FOR CLARITY.
4. THE WIRE SHALL BE FASTENED TO THE PIPE AT 5' INTERVALS
5. INSTALL MAGNESIUM GROUNDING ANODE IN TRENCH AT THE SAME ELEVATION AS THE PIPE AT ALL DEAD ENDS AND STUBS.

REV. DATE:	01/2026	WATER TRACER WIRE SYSTEM
SCALE:	N.T.S.	

NTM NORTH TABLE MOUNTAIN WATER AND SANITATION DISTRICT

14806 WEST 52ND AVENUE GOLDEN, COLORADO 80403-1228

DWG. NO. W11

P:\Engineering\Standard Drawings\Standard drawing.dwg, 1/20/2026 4:20:04 PM